



Generating Set Base Frame - diesel

GE.BD.1120/1020.BF+011

1500 rpm - Threephase - 50Hz - 400V Automatic Panel with AMF without ATS



Image for demonstration purposes

Standard equipment

Exhaust

Exhaust manifold protection Silenced muffler -15dB(A)

Fuel Supply

Fuel connections Automatic shutdown system for low fuel level

Handling

N.4 lifting hooks integrated into the bearing structure

Base Frame

Anti-vibrating mounting pads

Engine

High coolant temperature and low oil pressure shutdown

Oil pressure and coolant temperature gauge (only with qpe or +14 variant)

Oil change pump

Engine liquids (oil and antifreeze)

Tropicalized radiator

Rotating parts protection

Electronic speed governor

Alternator

Avr automatic voltage regulator Avr pre-arranged for parallel Three-phase sensing avr Impregnation for marine environment

Panel & connection

Emergency stop button Magnetothermal circuit breaker on alternator board Cable output from side lp44 wiring Start-up battery (pre-charged) Grounding point

Documentation

Ce conformity declaration User and maintenance manual Wirings diagrams

Normatives

All generating sets are compliant to CE marking 2014/30/UE electromagnetic compatibility 2000/14/CE noise emission for outdoor use Factory-designed systems built according to ISO 9001:2015 CEI EN 60204-1:2018 - Electrical equipment of machines













Weight with liquids (excluding optionals and fuel)



Primary data

| Speed | RPM | 1500 |
|---|----------------------|---|
| Frequency | Hz | 50 |
| PRP | KVA | 1020 |
| Prp - prime power | KW | 816,0 |
| Ltp - standby power | KVA | 1120 |
| Ltp - standby power | KW | 896,0 |
| Standard voltage | V | 400/230 |
| Current | Α | 1474,0 |
| Cosfi | 0,8 | 0,8 |
| General electrical protection | | |
| Circuit-breaker rated current | A | 1600 |
| Туре | | Magnetothermal switch on the alternator board |
| Circuit-breaker poles | N | 4P |
| Fuel Consumption | | diesel |
| Type | | alesei |
| Type Standard fuel tank capacity | | No tank |
| | lt lt/h | |
| Standard fuel tank capacity | | No tank |
| Standard fuel tank capacity Fuel consumption at 100% load | lt/h | No tank 205 |
| Standard fuel tank capacity Fuel consumption at 100% load Fuel consumption at 75% load | lt/h lt/h | No tank 205 154 |
| Standard fuel tank capacity Fuel consumption at 100% load Fuel consumption at 75% load Fuel consumption at 50% load | lt/h lt/h | No tank 205 154 |
| Standard fuel tank capacity Fuel consumption at 100% load Fuel consumption at 75% load Fuel consumption at 50% load General data | lt/h lt/h lt/h | No tank 205 154 105,7 |
| Standard fuel tank capacity Fuel consumption at 100% load Fuel consumption at 75% load Fuel consumption at 50% load General data Rated capacity | lt/h lt/h Ah | No tank 205 154 105,7 4x180 |
| Standard fuel tank capacity Fuel consumption at 100% load Fuel consumption at 75% load Fuel consumption at 50% load General data Rated capacity Auxiliary voltage | lt/h lt/h lt/h Ah | No tank 205 154 105,7 4x180 24 |

Kg (+/-3%)

7334







| Factory | | Baudouin |
|------------------------|------|--------------------------------|
| Model | | 12M26G1100/5 |
| Emissions stage | | Stage 0 |
| Speed governor | | Electronic |
| Radiator | °C | 50 |
| Cooling | Tipo | liquid (water + 50% Paraflu11) |
| Active net power | Kwm | 857,4 |
| Nominal net power | CV | 1164,9 |
| Cycle | Tipo | 4 strokes |
| Aspiration | Тіро | Turbo |
| Numbers of cylinders | N | 12 |
| Cylinders arrangement | | v |
| Bore | mm | 150 |
| Stroke | mm | 150 |
| Total displacement | lt | 31,793 |
| Engine oil features | | 15W40-API CI-4/CH-4 ACEA E5-E7 |
| Total oil capacity | lt | 109 |
| Total coolant capacity | lt | 191 |
| lso 8528-5 class | | G2 |

Alternator

$\ensuremath{^{*}}$ May vary based on stock availability. However, a primary brand will be used.

| Factory | | Stamford |
|--------------------------------------|-------|-----------------------|
| Model | | HCI634J |
| Prime power prp 3ph+n | KVA | 1030 |
| Voltage regulator (voltage accuracy) | +/- % | 0,5 |
| Poles | N° | 4 |
| Phases | N° | 3+N |
| Standard windings connection | | Star Series |
| Stator/rotor impregnation | | H (Outdoor Temp 40°C) |
| Efficiency | % | 95,1 |
| Engine coupling | | Elastic disk |
| Short circuit current | | >= 300% (3ln) |
| Protection degree | IP | 23 |
| Cooling system | | Self ventilating |
| Maxium overspeed | rpm | 2250 |
| Waveform distortion | % | <5 |
| Exciter | | PMG |

Standard operating environmental conditions


| Ambient temperature | °C | 25 |
|---------------------|----|------|
| Relative humidity | % | 30 |
| Max altitude | mt | 1000 |



GE.BD.1120/1020.BF+011

Control Systems on board QPE-C-VSC-BF





operating scheme - schema di funzionamento

The QPE-C control panel represents the evolution of the panel for the control and management of the gen set. With its microprocessor logic it is able to meet any user requested features. The dual operation mode manual and automatic guarantees to every type of functionality protection, analysis and control of the generating set in order to make the management easy and efficient. Variant without transfer switch on board. ATS panel type QC as optional. The panel manages the QC panels directly or any other ATS panel.

Mechanical features

| Duatastian dagge | ID | |
|-------------------|----|----|
| Protection degree | IP | 55 |

Battery charger

| Model | | ELCOS - CB1 |
|--------------------------------|-----|-------------|
| Maximum output current | Α | 2,5 |
| Output dc voltage (selectable) | Vdc | 12-24 |
| Input ac voltage (selectable) | Vac | 220-260 |
| Frequency | Hz | 50-60 |


Data Communication

| Data connection port | RS-485 |
|------------------------|-----------------|
| Communication protocol | Mod-bus RTU-8N1 |

Remotable functions in terminal box

Gs start
Genset contactor close/open command
Common alarm - dc output
Gs start with key in off position (only in mrs mode)
Management of the automatic fuel refilling system

Gs lock Mains contactor close/open command Gs test without load Programmable output - volt free output









Specifics

Applications

Emergency to the mains Stand-alone Construction site/rental Self-production

ENGINE MEASURES

Fuel tank level % Engine oil pressure bar (1) Engine coolant temperature °c (1) Total run time

Partial run time Hours to maintenance Battery voltage

Battery charging voltage Start-ups counter

Engine speed (2) Engine oil temperature (2)

Cooler temperature (2) Engine oil level (2) Engine coolant level (2)

Engine coolant pressure (2) Turbo pressure (2) Fuel consumption (2)

Tank autonomy - hrs (5) Fuel remaining quatity (5)

Fuel used quantity (5)

ALTERNATOR MEASURES

Generator voltage I1, I2, I3 Generator voltage I1-n, I2-n, I3-n Generator frequency Generator current 11, 12, 13 Generator apparent power kva Generator active power kw Generator reactive power kvar Generator accumulated power kwh Power factor cosfi

MAINS MEASURES

update

Mains voltage I1, I2, I3 Mains voltage I1-n, I2-n, I3-n Mains frequency

COMMUNICATION PORTS

Can-bus port Rs485 port with mod-bus rtu communication Rs232 port for display connection Usb port for parameters saving and firmware

EQUIPMENT

Microprocessor logic Back-lit display

Programmable from display

16 event log

Multiple display languages

Stop button Start button Test button

Reset alarm button Alarm mute button

Fuel transfer pump activation button

Glow-plug activation button

PRE-ALARMS/ ALARMS

Common alarm Fuel reserve (pre-alarm) Low fuel level (alarm)

Tank overflow Charge alternator failed (dinamo) Low oil pressure (pre-alarm) (1) Low oil pressure (alarm)

Oil sensor failed (alarm) High coolant temperature (pre-alarm) (1)

High coolant temperature (alarm) Low coolant temperature (pre-alarm)

Low water level (1) Water in fuel (1) Battery undervoltage Battery overvoltage Gs failure to start Gs failure to stop Can-bus failure

No can-bus communication Genset overload I1, I2, I3 phases

Genset short circuit Genset overvoltage Genset undervoltage Genset high frequency Genset low frequency Overspeed

Reverse power Earth fault (pre-alarm) Earth fault (alarm) Block from password Can communication failed Maintenance request Emergency button pressed Remote emergency active

Forced stop

External battery failed

Fuel theft

Genset negative phase sequence Mains negative phase sequence

Fuel theft protection

VISUALIZATIONS ON CONTROL MODULE/DISPLAY

ELCOS

MC4 AMF - MRS

Pre-alarms Alarms

Brand

Model

Operating mode

Engine measures Alternator measures Mains measures Date and time Operating mode Genset status

Mains status

Mains contactor status Genset contactor status Digital input and output status Grounding current ma (3) Grounding current threshold ma (3) Delay time of differential protection (3)

CONTROL MODULE FUNCTIONS

Automatic start and stop when the mains fails (7)

Remote start and stop

Glow plugs status

Remote start and stop with key in off position

Manual start and stop

Emergency stop button on panel board

Remote emergency stop

Remote lock

Remote test without load Remote test on load Scheduled start-ups

Modbus commands (start, stop, reset, test)

CONTROL MODULE SPECIAL FUNCTIONS (on demand)

Automatic charging of an external battery Dummy load (4)

Load shedding (4)

Redundant starter motor management

Fuel monitoring Gs battery load test Idle mode

Service phone number indication Variable speed generator

Master / slave mode





OPTIONAL

Canopy Soundproofing

Air inlet/outlet sound attenuator for room Soundproof container of various sizes

Exhaust

Exhaust flexible expansion joint External residential muffler Exhaust flexible pipe (fap) anti-particulate filter Exhaust catalyst (cat)

Fuel Supply

Single wall daily tank with bunded base Automatic fuel refilling system on trestle

Engine

Engine pre-heater 230vsuper hot Engine liquids + 50°c, - 40°c (oil and antifreeze) Battery disconnector Automatic refilling oil system Cyclone air filter Redundant start-up battery kit

Alternator

Stator windings thermistors - pt100 - in the alternator box (not managed) $\,$

Bearing thermistor - pt100 - in the alternator box (not managed) Anti-condensation heater

Double bearing lp44

Panel & connection

Rcd with adjustable current and excludible Automatic transfer switch (qc) Utf energy meter with arcudi terminal Tamperproof panel ip55

MC4 optional

Telemonitoring with software
Remote panel
Rs485/usb converter
Rs485/lan converter
16 relais card (volt free output)
Gms modem - sms remote management
Radiocontrol
Gsm remote control system with web application without sim card
Gps tracking system

PRP


Engines of this rating provide unlimited hours of usage in a variable load application. The average load factor should not exceed 70% of the engine's prime power rating with a maximum number of 500 operational hours at 100% prime power rating. An overload capability of 10% is available, however, is limited to a period of 1 in every 12 hours

LTP

Limited-time running power is defined as the maximum power available, under the agreed operating conditions, for which the generating set is capable of delivering for up to 500h of operation per year with the maintenance intervals. The overload is not allowed.






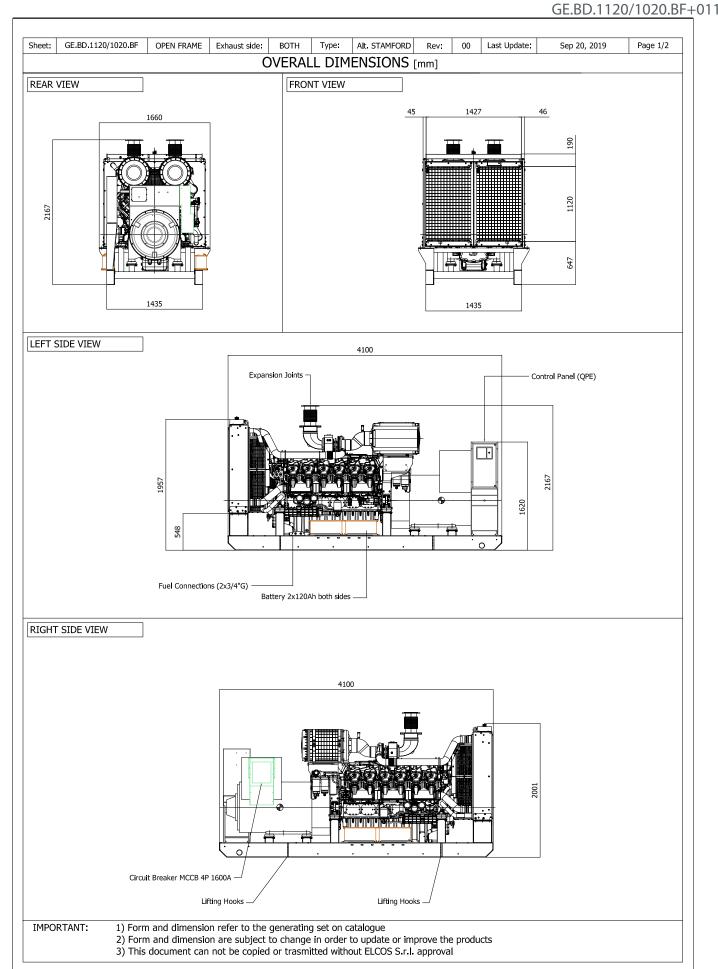





GE.BD.1120/1020.BF+011

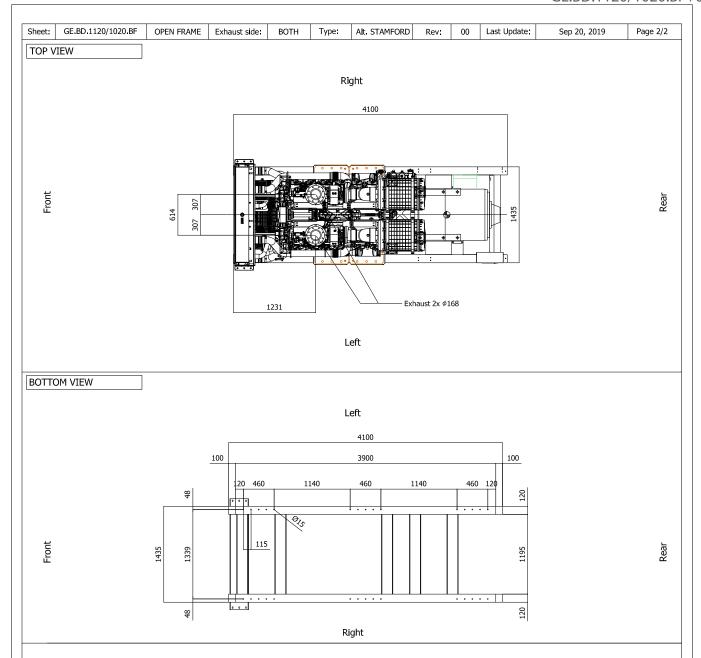

VENTILATION OF THE ROOM

The windows area in the generating set room needs to be (recommended):

Aspiration: 3.8 m2

Expulsion: 3.0 m2

ATTENTION: for a correct ventilation the expulsion air and the exaust gas needs to be conveyed in the open-air

IMPORTANT:

- 1) Form and dimension refer to the generating set on catalogue
- 2) Form and dimension refer to the generating set of catalogue2) Form and dimension are subject to change in order to update or improve the products3) This document can not be copied or trasmitted without ELCOS S.r.l. approval