



**Generating Set Base Frame - diesel** 

# GE.DW.625/560.BF+011

1500 rpm - Threephase - 50Hz - 400V Automatic Panel with AMF without ATS



Image for demonstration purposes

# Standard equipment

## Exhaust

Exhaust manifold protection Silenced muffler -15dB(A)

## Fuel Supply

Single wall daily tank with bunded base Automatic shutdown system for low fuel level Fuel gauge

# **Handling**

N.4 lifting hooks integrated into the bearing structure

## Base Frame

Bunded base at 110% of fuel tank capacity Anti-vibrating mounting pads

### Engine

High coolant temperature and low oil pressure shutdown

Oil pressure and coolant temperature gauge (only with qpe or +14 variant)

External oil drain points

Engine liquids (oil and antifreeze)

Rotating parts protection

Electronic speed governor

## Alternator

Avr automatic voltage regulator Avr pre-arranged for parallel Three-phase sensing avr Impregnation for marine environment

## Panel & connection

Emergency stop button Magnetothermal circuit breaker on alternator board Cable output from side lp44 wiring Start-up battery (pre-charged) Grounding point

## Documentation

Ce conformity declaration User and maintenance manual Wirings diagrams

## Normatives

All generating sets are compliant to CE marking 2014/30/UE electromagnetic compatibility 2000/14/CE noise emission for outdoor use Factory-designed systems built according to ISO 9001:2015 CEI EN 60204-1:2018 - Electrical equipment of machines















# **Primary data**

Speed	RPM	1500
Frequency	Hz	50
PRP	KVA	570
Prp - prime power	KW	456,0
Ltp - standby power	KVA	630
Ltp - standby power	KW	504,0
Standard voltage	V	400/230
Current	Α	823,7
Cosfi	0,8	0,8
General electrical protection		
- deficial electrical protection		****
Circuit-breaker rated current	A	1000
Type		Magnetothermal switch on the alternator board
Circuit-breaker poles	N	4P
Fuel Consumption		
Туре		diesel
Standard fuel tank capacity	lt	400
Autonomy @ 75% load	h	5
Fuel consumption at 100% load	lt/h	123,6
Fuel consumption at 75% load	lt/h	94,2
Fuel consumption at 50% load	lt/h	64,8
General data		
	AL	2::100
Rated capacity  Auditory voltage	Ah	2x180
Auxiliary voltage	V	24
Exhaust gas temperature	℃	540
Exhaust gas flow	l/s	1600
Combustion air flow	l/s	515
Cooling fan airflow	mc/s	11,6
Weight and Dimensions		

Kg (+/-3%)

4120

Weight with liquids (excluding optionals and fuel)





# Engine

Factory		Doosan
Model		DP180LAF
Emissions stage		Stage 0
Speed governor		Electronic
Radiator	°C	43
Cooling	Tipo	liquid (water + 50% Paraflu11)
Active net power	Kwm	486
Nominal net power	CV	660,3
Cycle	Tipo	4 strokes
Injection	Tipo	Direct
Aspiration	Tipo	Turbo
Numbers of cylinders	N	10
Cylinders arrangement		v
Bore	mm	128
Stroke	mm	142
Total displacement	lt	18,263
Engine oil features		15W40-API CI-4/CH-4 ACEA E5-E7
Total oil capacity	lt	34
Total coolant capacity	lt	91
Iso 8528-5 class		G2

## Alternator

## \* May vary based on stock availability. However, a primary brand will be used.

Factory		Marelli
Model		MJB 355 SB4
Prime power prp 3ph+n	KVA	570
Voltage regulator (voltage accuracy)	+/- %	0,5
Poles	N°	4
Phases	N°	3+N
Standard windings connection		Star Series Star Series
Stator/rotor impregnation		H (Outdoor Temp 40°C)
Efficiency	%	95,1
Engine coupling		Elastic disk
Short circuit current		>= 300% (3In)
Protection degree	IP	23
Cooling system		Self ventilating
Maxium overspeed	rpm	2250
Exciter		Diode bridge

# Standard operating environmental conditions


Ambient temperature	°C	25
Relative humidity	%	30
Max altitude	mt	1000



GE.DW.625/560.BF+011

# **Control Systems on board QPE-C-VSC-BF**





operating scheme - schema di funzionamento

# 

The QPE-C control panel represents the evolution of the panel for the control and management of the gen set. With its microprocessor logic it is able to meet any user requested features. The dual operation mode manual and automatic guarantees to every type of functionality protection, analysis and control of the generating set in order to make the management easy and efficient. Variant without transfer switch on board. ATS panel type QC as optional. The panel manages the QC panels directly or any other ATS panel.

# Mechanical features

Duatastian dagge	ID	
Protection degree	IP	55

# Battery charger

	ELCOS - CB1
Α	2,5
Vdc	12-24
Vac	220-260
Hz	50-60
	Vdc Vac

# Data Communication

Data connection port	RS-485
Communication protocol	Mod-bus RTU-8N1

# Remotable functions in terminal box

Gs start
Genset contactor close/open command
Common alarm - dc output
Gs start with key in off position (only in mrs mode)
Management of the automatic fuel refilling system

Gs lock
Mains contactor close/open command
Gs test without load
Programmable output - volt free output







# Control Module



#### **Specifics**

#### **Applications**

Emergency to the mains Stand-alone Construction site/rental Self-production

#### **ENGINE MEASURES**

Fuel tank level %

Engine oil pressure bar (1)

Engine coolant temperature °c (1)

Total run time

Partial run time

Hours to maintenance

Battery voltage

Battery charging voltage

Start-ups counter

Engine speed (2)

Engine oil temperature (2)

Cooler temperature (2)

Engine oil level (2)

Engine coolant level (2)

Engine coolant pressure (2)

Turbo pressure (2)

Fuel consumption (2)

Tank autonomy - hrs (5)

Fuel remaining quatity (5)

Fuel used quantity (5)

#### **ALTERNATOR MEASURES**

Generator voltage I1, I2, I3

Generator voltage I1-n, I2-n, I3-n

Generator frequency

Generator current 11, 12, 13

Generator apparent power kva

Generator active power kw

Generator reactive power kvar

Generator accumulated power kwh

Power factor cosfi

#### **MAINS MEASURES**

Mains voltage I1, I2, I3 Mains voltage I1-n, I2-n, I3-n

Mains frequency

### **COMMUNICATION PORTS**

Can-bus port

Rs485 port with mod-bus rtu communication

Rs232 port for display connection

Usb port for parameters saving and firmware

update

#### **EQUIPMENT**

Microprocessor logic

Back-lit display

Programmable from display

16 event log

Multiple display languages

Stop button

Start button

Test button

Reset alarm button

Alarm mute button

Fuel transfer pump activation button

Glow-plug activation button

#### PRE-ALARMS/ ALARMS

Common alarm

Fuel reserve (pre-alarm)

Low fuel level (alarm)

Tank overflow

Charge alternator failed (dinamo)

Low oil pressure (pre-alarm) (1)

Low oil pressure (alarm)

Oil sensor failed (alarm)

High coolant temperature (pre-alarm) (1)

High coolant temperature (alarm)

Low coolant temperature (pre-alarm)

Low water level (1)

Water in fuel (1)

Battery undervoltage Battery overvoltage

Gs failure to start

Gs failure to stop

Can-bus failure

No can-bus communication

Genset overload I1, I2, I3 phases

Genset short circuit

Genset overvoltage Genset undervoltage

Genset high frequency

Genset low frequency

Overspeed

Reverse power

Earth fault (pre-alarm) Earth fault (alarm)

Block from password

Can communication failed

Maintenance request

Emergency button pressed

Remote emergency active

Forced stop

External battery failed

Fuel theft

Genset negative phase sequence

Mains negative phase sequence

Fuel theft protection

## VISUALIZATIONS ON CONTROL

**ELCOS** 

MC4 AMF - MRS

#### MODULE/DISPLAY

Pre-alarms

**Brand** Model

Operating mode

Alarms

Engine measures

Alternator measures

Mains measures Date and time

Operating mode Genset status

Mains status

Mains contactor status

Genset contactor status

Digital input and output status

Grounding current ma (3)

Grounding current threshold ma (3)

Delay time of differential protection (3)

Glow plugs status

#### **CONTROL MODULE FUNCTIONS**

Automatic start and stop when the mains fails (7)

Remote start and stop

Remote start and stop with key in off position

Manual start and stop Emergency stop button on panel board

Remote emergency stop

Remote lock

Remote test without load

Remote test on load

Scheduled start-ups

Modbus commands (start, stop, reset, test)

#### **CONTROL MODULE SPECIAL FUNCTIONS** (on demand)

Automatic charging of an external battery

Dummy load (4) Load shedding (4)

Redundant starter motor management

Fuel monitoring

Gs battery load test

Idle mode Service phone number indication

Variable speed generator

Master / slave mode



## **OPTIONAL**



Air inlet/outlet sound attenuator for room Soundproof container of various sizes

# Exhaust

Exhaust flexible expansion joint External residential muffler Exhaust flexible pipe (fap) anti-particulate filter Exhaust catalyst (cat)

# Fuel Supply

Bulk tank connections with 3 way valve Bulk tank connections Automatic fuel refilling system on board

## Engine

Engine pre-heater 230vsuper hot
Oil change pump
Engine liquids + 50°c, - 40°c (oil and antifreeze)
Tropicalized radiator
Battery disconnector
Automatic refilling oil system
1000 working hours spare parts kit
Cyclone air filter
Redundant start-up battery kit

## Alternator

Stator windings thermistors - pt100 - in the alternator box (not managed)  $\,$ 

Bearing thermistor - pt100 - in the alternator box (not managed) Anti-condensation heater Double bearing

## Panel & connection

Rcd with adjustable current and excludible Automatic transfer switch (qc) Utf energy meter with arcudi terminal Tamperproof panel ip55

# MC4 optional

Telemonitoring with software
Remote panel
Rs485/usb converter
Rs485/lan converter
16 relais card (volt free output)
Gms modem - sms remote management
Radiocontrol
Gsm remote control system with web application without sim card
Gps tracking system

### **PRP**


Engines of this rating provide unlimited hours of usage in a variable load application. The average load factor should not exceed 70% of the engine's prime power rating with a maximum number of 500 operational hours at 100% prime power rating. An overload capability of 10% is available, however, is limited to a period of 1 in every 12 hours

### **LTP**

Limited-time running power is defined as the maximum power available, under the agreed operating conditions, for which the generating set is capable of delivering for up to 500h of operation per year with the maintenance intervals. The overload is not allowed.




GE.DW.625/560.BF+011

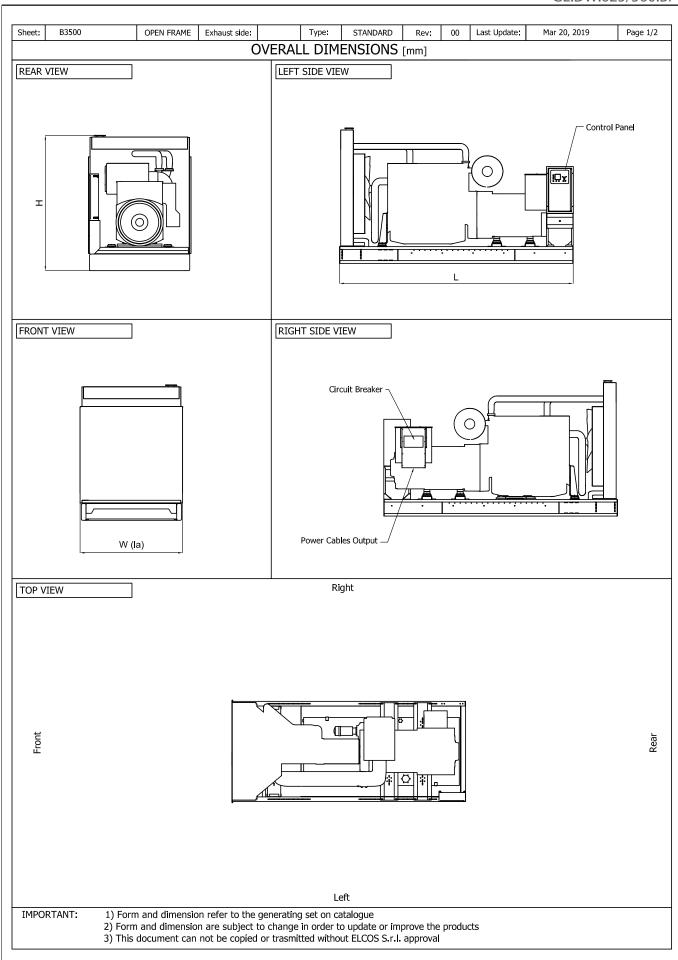





GE.DW.625/560.BF+011

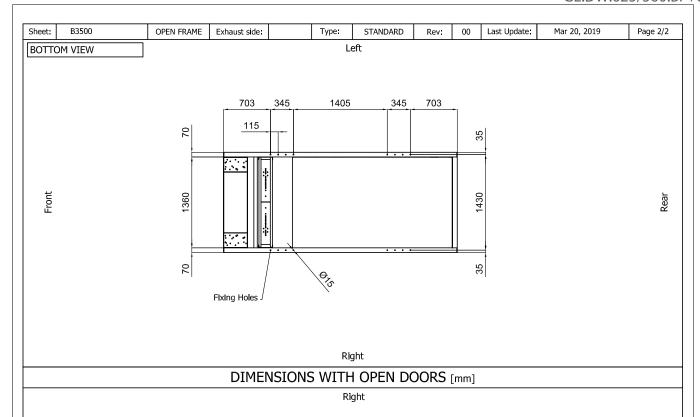

Front Rear

Left

## VENTILATION OF THE ROOM

The windows area in the generating set room needs to be (recommended):

Aspiration: on request Expulsion: on request

ATTENTION: for a correct ventilation the expulsion air and the exaust gas needs to be conveyed in the open-air

IMPORTANT:

- 1) Form and dimension refer to the generating set on catalogue
- 2) Form and dimension are subject to change in order to update or improve the products
  3) This document can not be copied or trasmitted without ELCOS S.r.l. approval